


מושחל בצינור - EXTERNAL SENSOR (OPTION)
 פלסטי מתאים (TS05 or TS06 ONLY!)

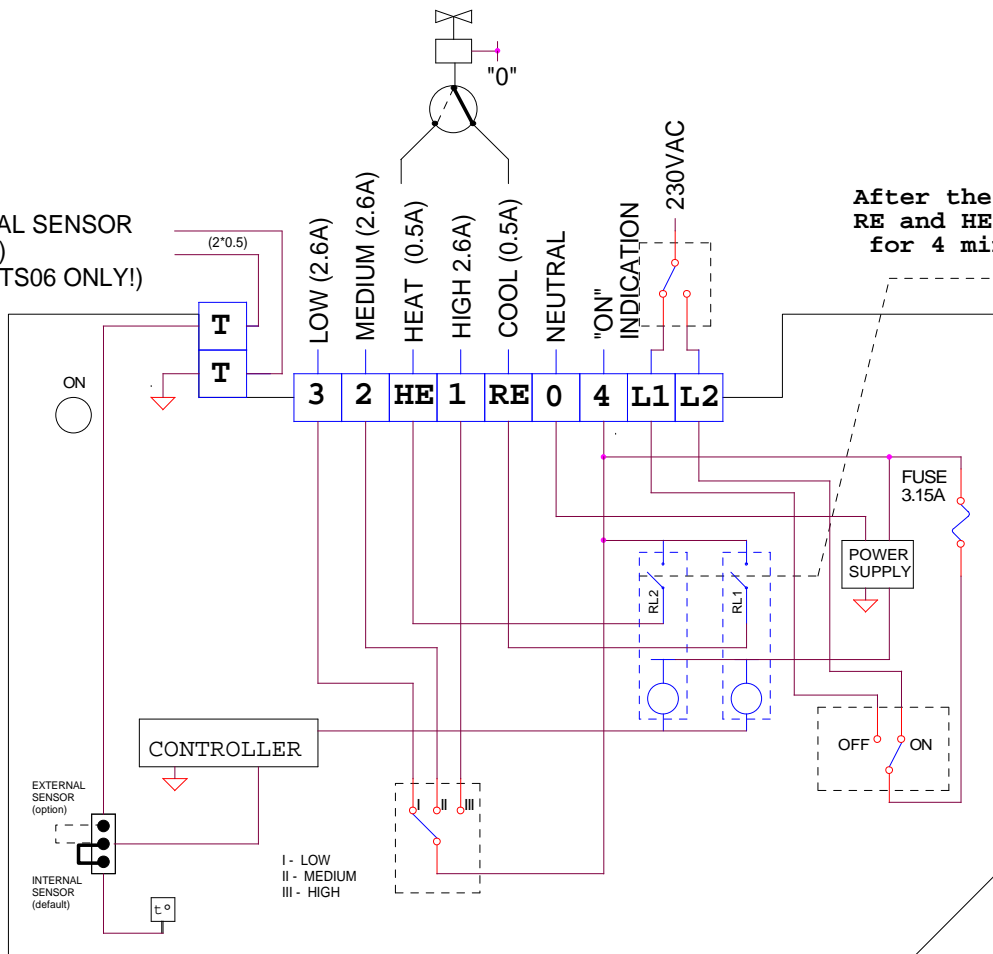

After the thermostat "ON",
 RE and HE outputs operate together
 for 4 min, every 1 hour

meitav-tec

Tel: 03-9626462 Fax: 03-9626620
 email: support@meitavtec.com

Title: **EP2/C.O/CH**

Date: 05/08/2008

DWG No. 10207

2	Fix Switch 3 speed	05.08.08
1	Original	14.07.05
No.	Revision	Date

Print name:	EP2-EX
Software name:	EP2_EX
Check sum:	C8DD
File name:	EP2-CO-CH.DSN

Drawn:	Marina
Checked:	Oleg
Approved:	Elan